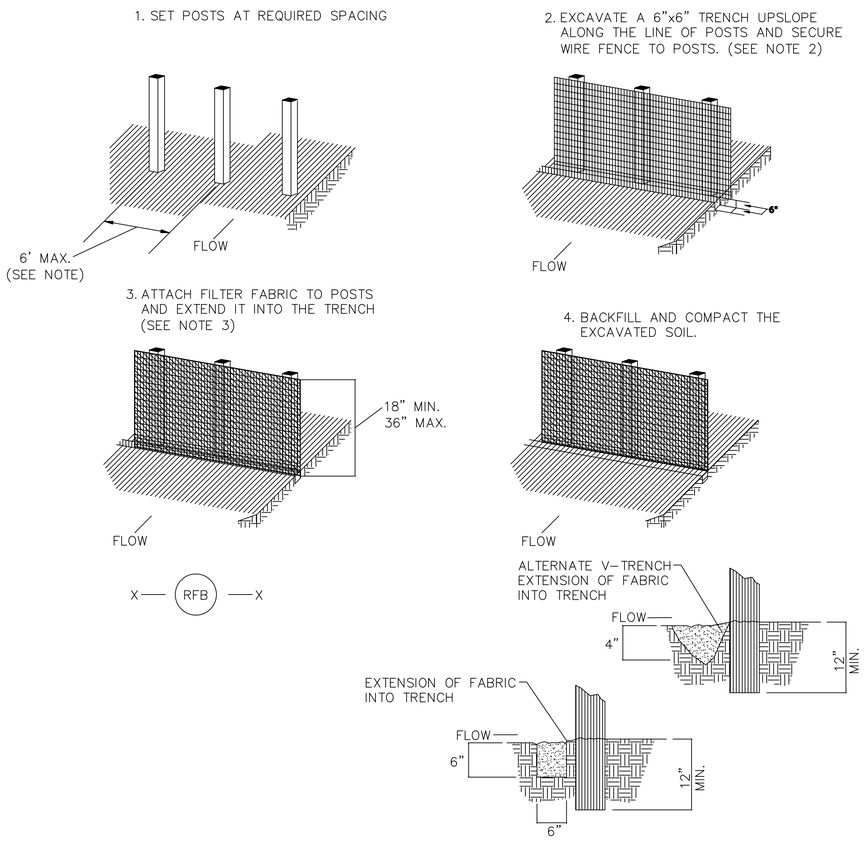

REINFORCED FILTER FABRIC BARRIER

N.T.S.

GENERAL NOTES:

1. POSTS TO BE SET AT 6 FOOT MAXIMUM SPACING.
2. WOVEN WIRE FENCE TO BE FASTENED SECURELY TO POSTS WITH WIRE TIES OR STAPLES ADDITIONAL TIES OR STAPLES CAN BE ADDED TO SECURE WOVEN WIRE FENCE.
3. FILTER FABRIC TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH WIRE TIES OR STAPLES AT TOP AND MIDSECTION. ADDITIONAL TIES OR STAPLES CAN BE ADDED TO SECURE FABRIC.
   WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHOULD BE OVERLAPPED 6" INCHES AT THE POSTS AND FOLDED.
4. CUT "D" SHAPED HOLES ½ OF HEIGHT AWAY FROM NATURAL GROUND AND SPACED NO MORE THAN 4 FEET ON-CENTER.

CONSTRUCTION NOTES:

1. 2 INCH THICK BY 2 INCH WOODEN STAKES TO BE SET AT MAX SPACING OF 16 FEET AND EMBEDDED A MIN. OF 12 INCHES. IF PREASSEMBLED FENCE WITH SUPPORT NETTTING IS USED, SPACING OF POST MAY BE INCREASED TO 8 FEET MAX.
2. ATTACH FILTER FABRIC TO WOODEN STAKES. FILTER FABRIC FENCE SHALL HAVE A MIN. HEIGHT OF 18 INCHES AND MAX. HEIGHT OF 36 INCHES ABOVE NATURAL GROUND.
3. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHOULD BE OVERLAPPED 6 INCHES AT THE POSTS, AND FOLDED.
4. SEE STANDARD SPECIFICATION FOR FILTER FABRIC FENCE.

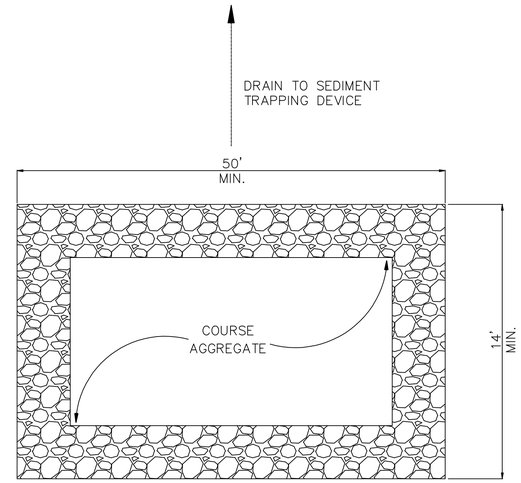

PLAN

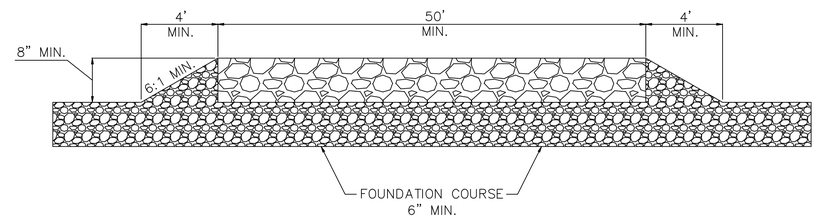

PROFILE

CONSTRUCTION EXIT (TYPE 1)

N.T.S.

GENERAL NOTES:

1. THE LENGTH OF THE TYPE 1 CONSTRUCTION EXIT SHALL BE AS INDICATED ON THE PLANS, BUT NOT LESSS THAN 50'.
2. THE COARSE AGGREGATE SHOULD BE OPENED GRADED WITH A SIZE OF 4" TO 8".
3. THE APPROACH TRANSITIONS SHOULD BE NO STEEPER THAN 6:1 AND CONSTRUCTED AS DIRECTED BY THE ENGINEER.
4. THE CONSTRUCTION EXIT FOUNDATION COURSE SHALL BE FLEXIBLE BASE, BITUMINOUS CONCRETE, PORTLAND CEMENT CONCRETE OR OTHER MATERIAL AS APPROVED BY THE ENGINEER.
5. THE CONSTRUCTION EXIT SHALL BE GRADED TO ALLOW DRAINAGE TO A SEDIMENT TRAPPING DEVICE.
6. THE GUIDELINES SHOWN HEREON ARE SUGGESTIONS ONLY AND MAY BE MODIFIED BY THE ENGINEER.
7. THE LOCATION AND NUMBER OF CONSTRUCTION EXITS SHALL BE APPROVED BY THE ENGINEER.

CITY OF LA PORTE
PLANNING DEPT.ENGINEERING DIV.
604 W. FAIRMONT PKWY.
LA PORTE. TEXAS, 77571
281-471-5020; FAX: 281-470-5005

DWN:	JR
CK'D:	RS
APP'D:	RS
Scale:	N.T.S.
Date:	May, 2007
Project No.:	2007-4502
SHEET:	7 OF 8

SW3P DETAILS